



DIVERSION BERM REQUIRED
WHERE GRADE EXCEEDS 2%.

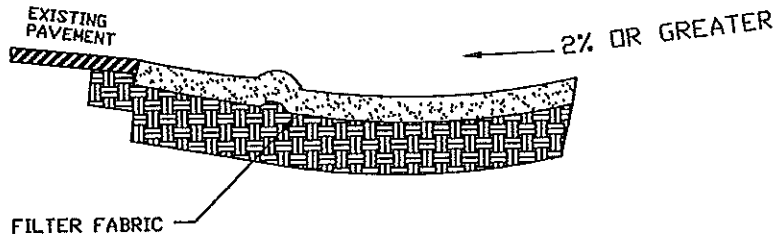

SECTION A-A

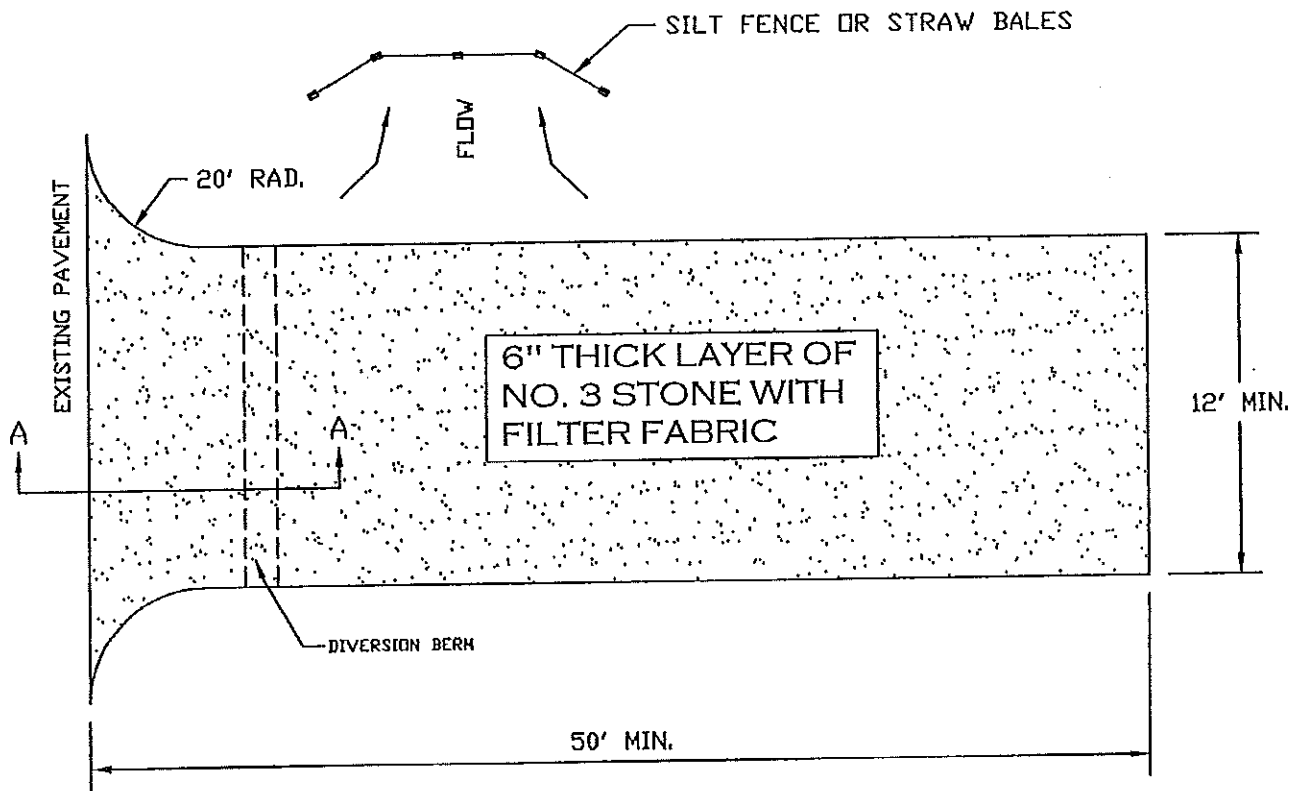

NOTE NO. 1:

THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHT-OF-WAYS OR UNTO BASE MATERIAL.

TEMPORARY GRAVEL ENTRANCE/EXIT
STANDARD DETAIL 400




City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 400.DWG

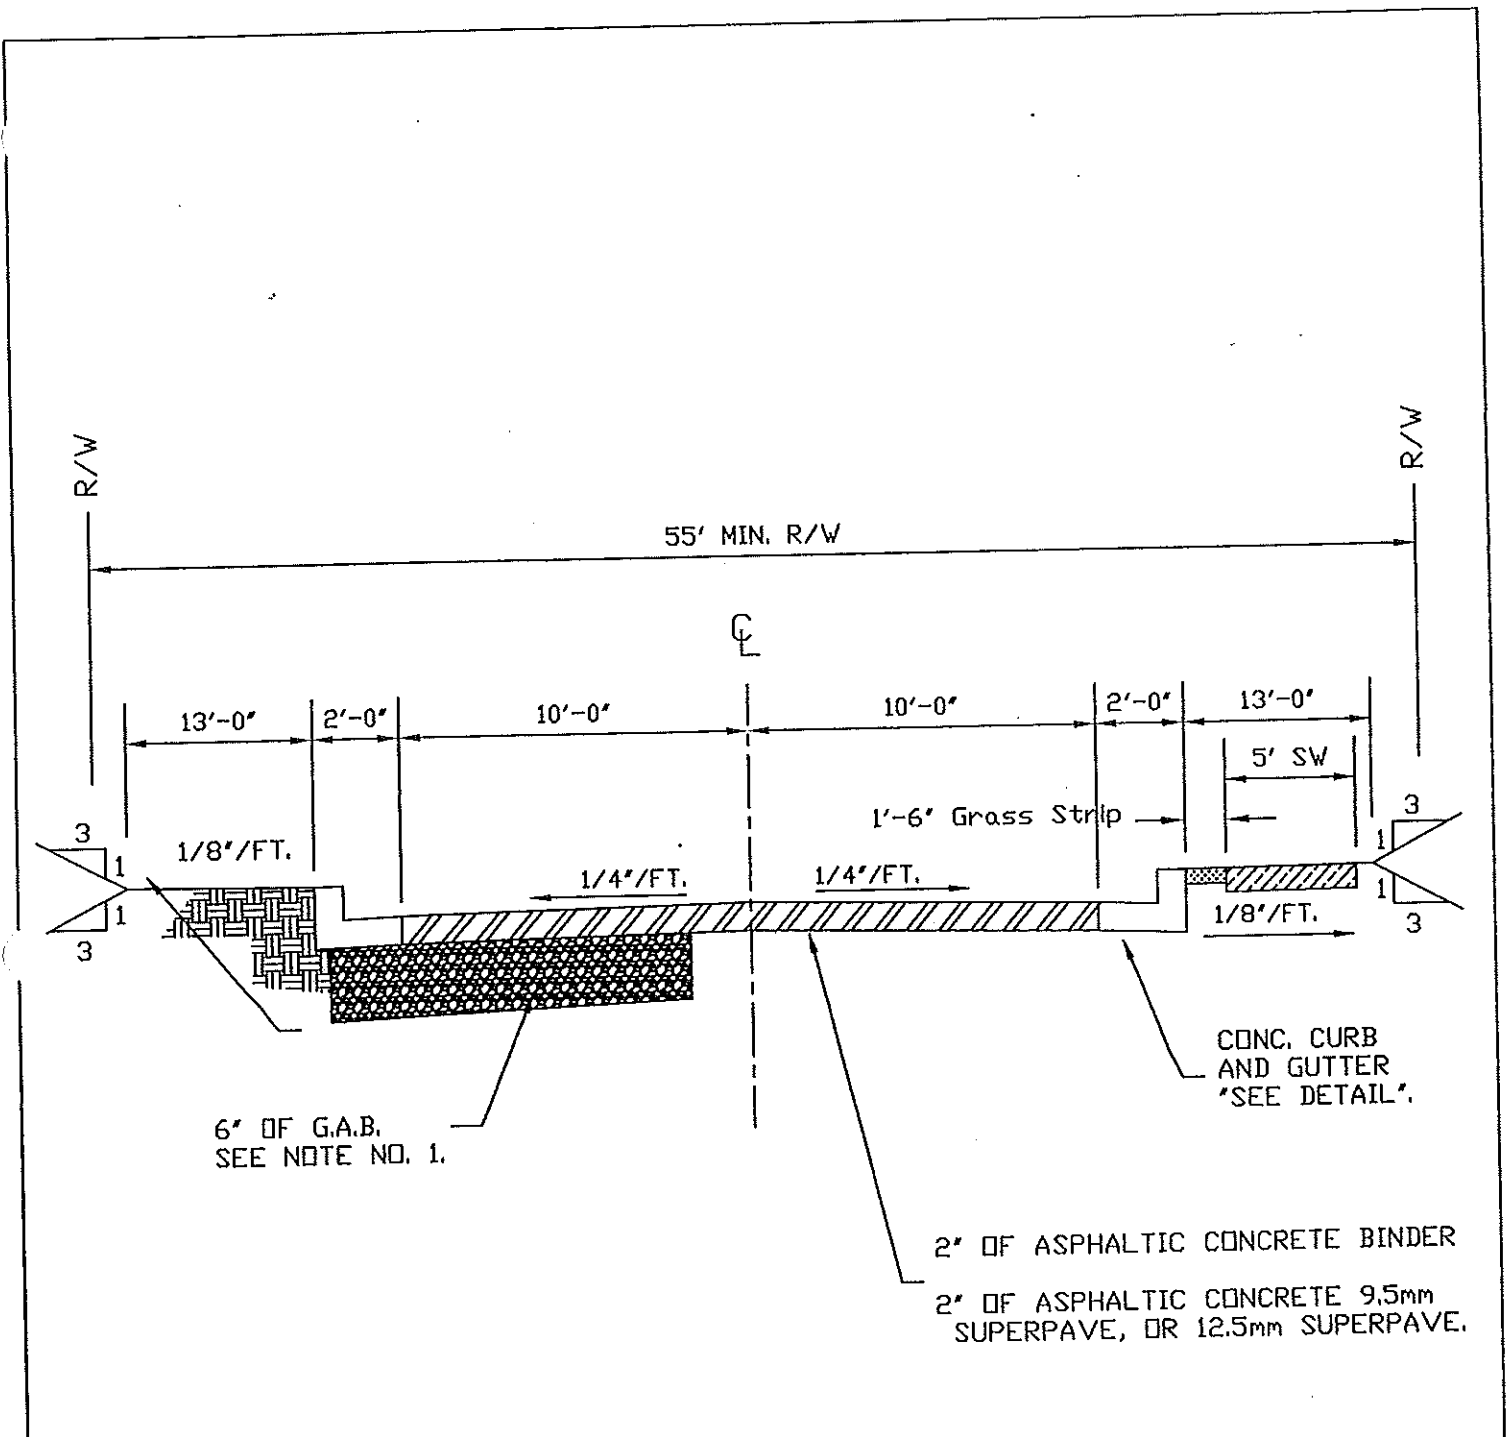

6" OF G.A.B.
SEE NOTE NO. 1.

CONC. CURB
AND GUTTER
"SEE DETAIL".

2" OF ASPHALTIC CONCRETE BINDER
2" OF ASPHALTIC CONCRETE 9.5mm
SUPERPAVE, OR 12.5mm SUPERPAVE.


NOTE NO. 1:
6 INCHES COMPACTED GRADED AGGREGATE BASE (GROUP I AGGREGATE),
98% MODIFIED PROCTOR MAXIMUM DRY DENSITY (AASHTO T-180)

LOCAL (RESIDENTIAL SUBDIVISION)
STANDARD DETAIL 401



City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH	SCALE: NTS	DATE: JANUARY 1, 2010	DWG. NO.: 401.DWG
--------------	------------	-----------------------	-------------------

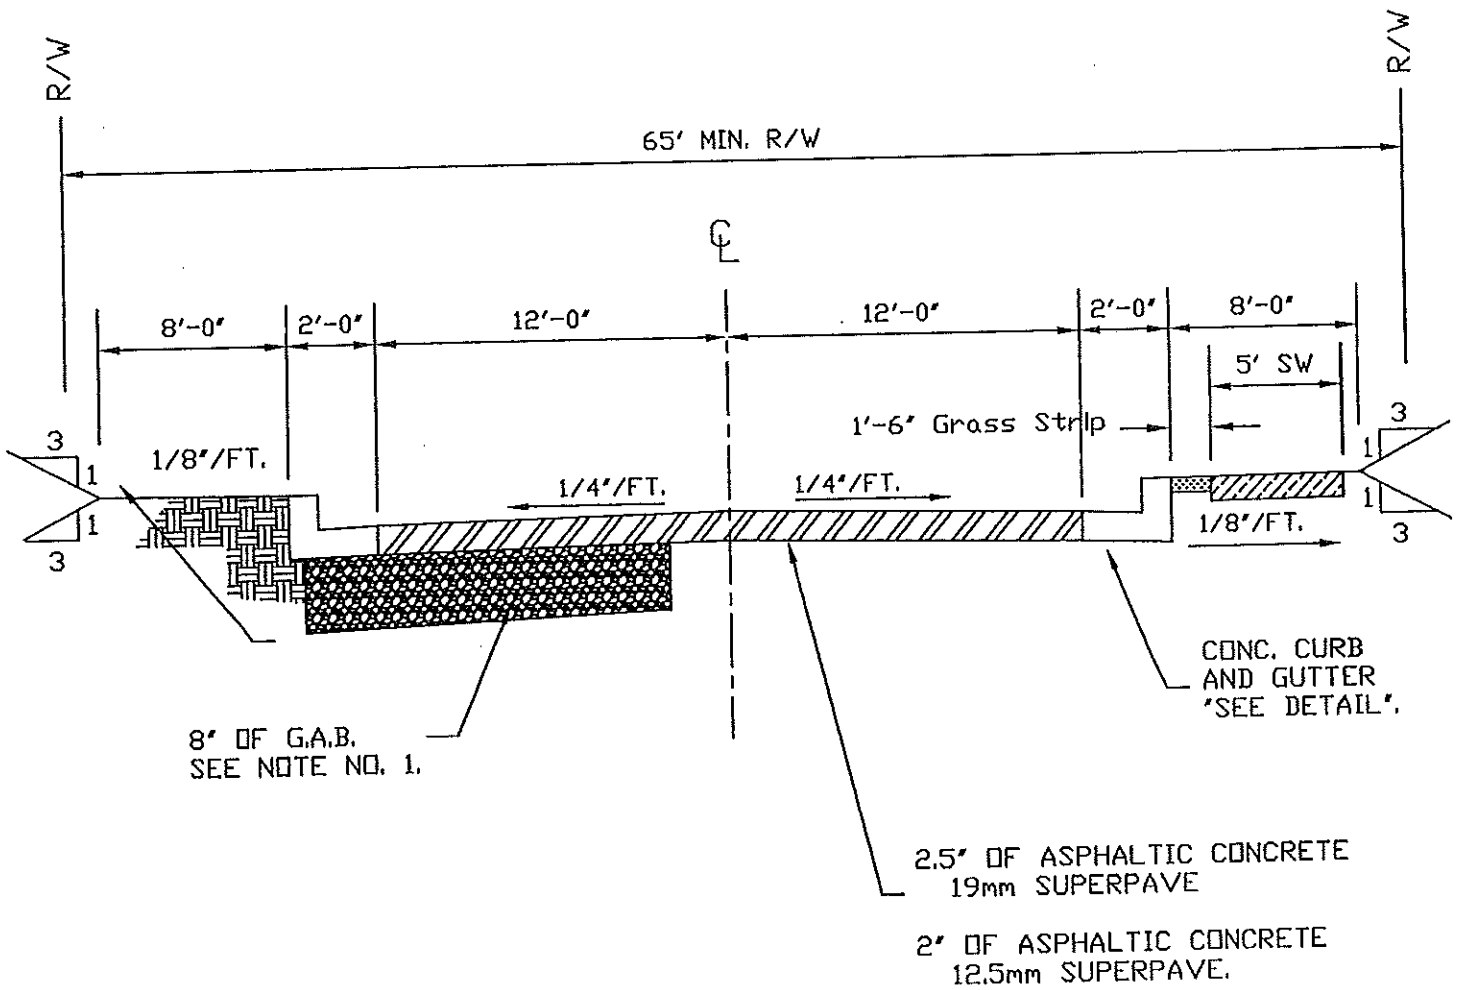

NOTE NO. 1:

8 INCHES COMPACTED GRADED AGGREGATE BASE (GROUP I AGGREGATE),
 98% MODIFIED PROCTOR MAXIMUM DRY DENSITY (AASHTO T-180)

COMMERCIAL
 STANDARD DETAIL 402




City of Calhoun
 Street Department
 P.O. BOX 248
 CALHOUN, GEORGIA 30701
 TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 402.DWG

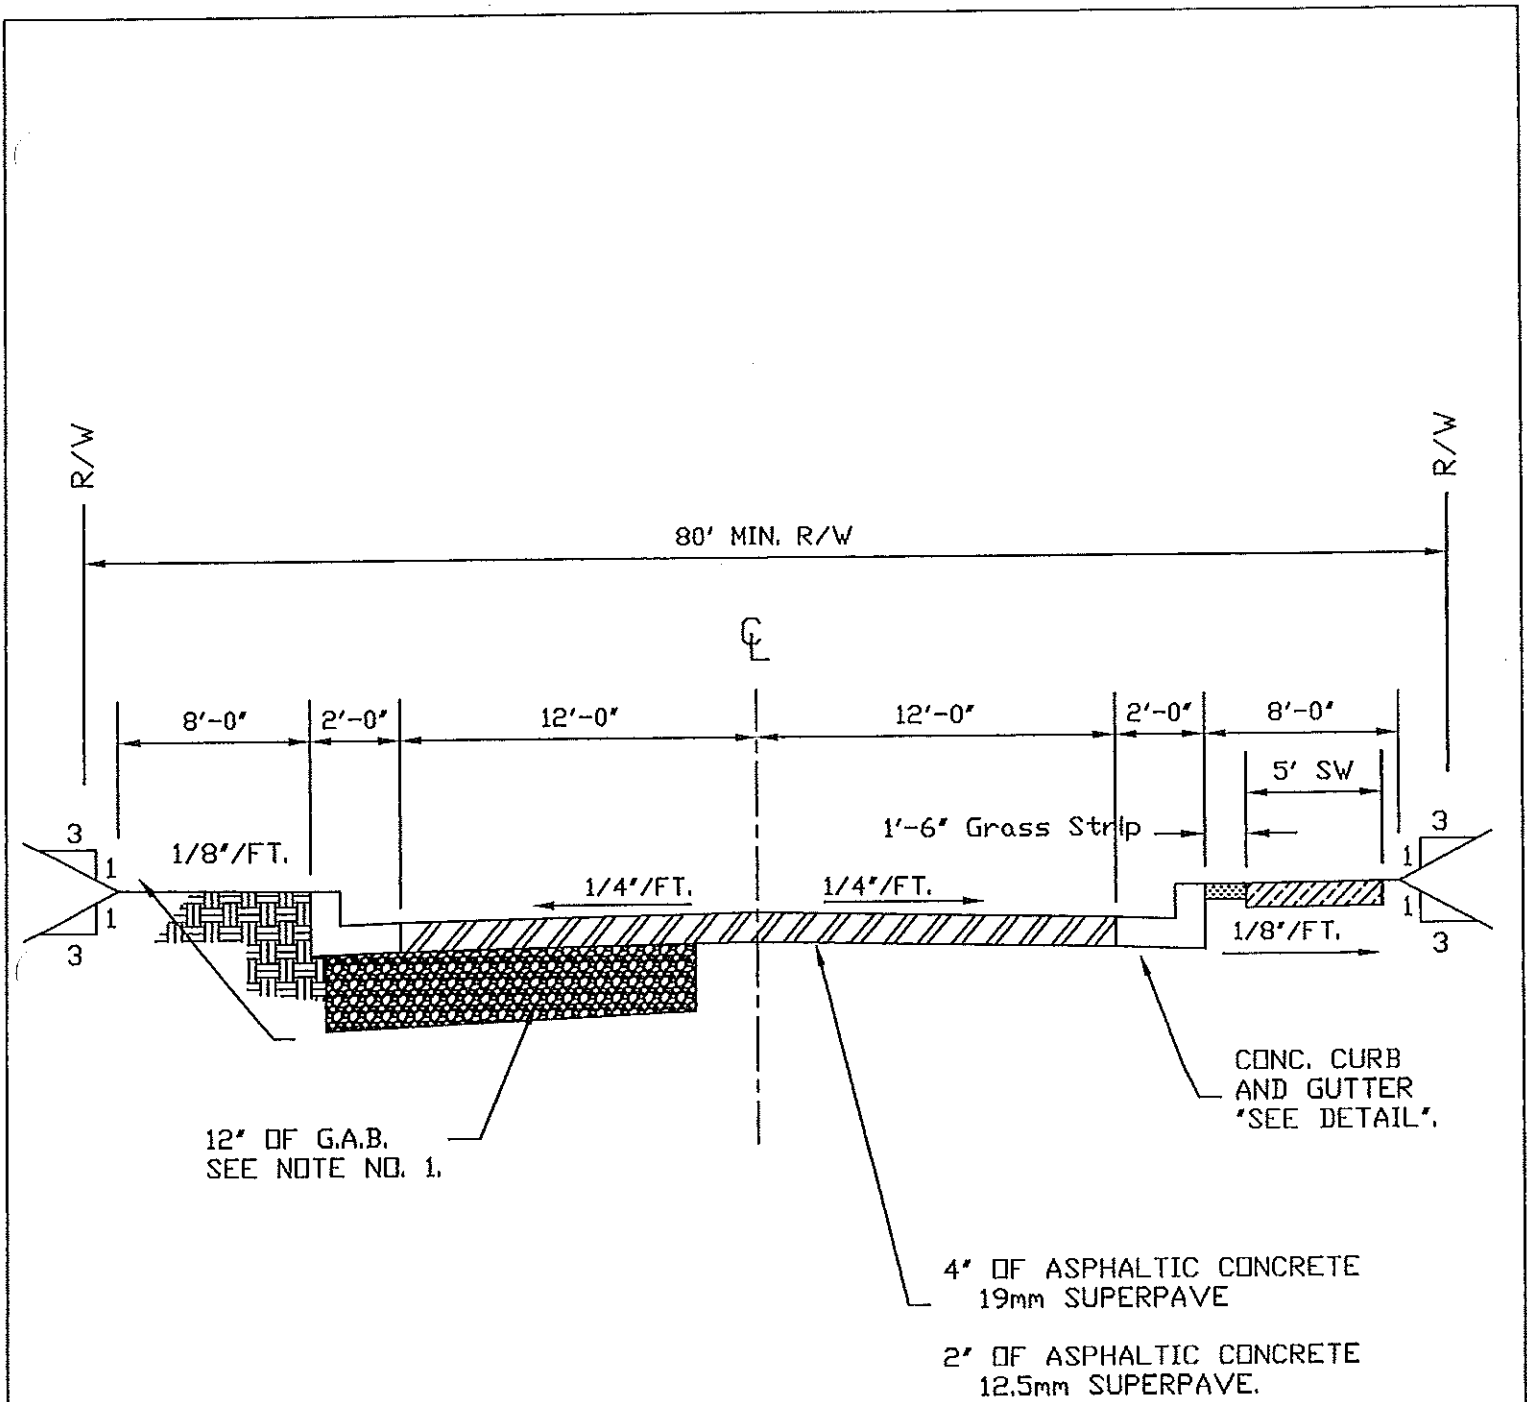

NOTE NO. 1:

12 INCHES COMPACTED GRADED AGGREGATE BASE (GROUP I AGGREGATE), 98% MODIFIED PROCTOR MAXIMUM DRY DENSITY (AASHTO T-180)

**INDUSTRIAL
STANDARD DETAIL 403**




City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 403.DWG

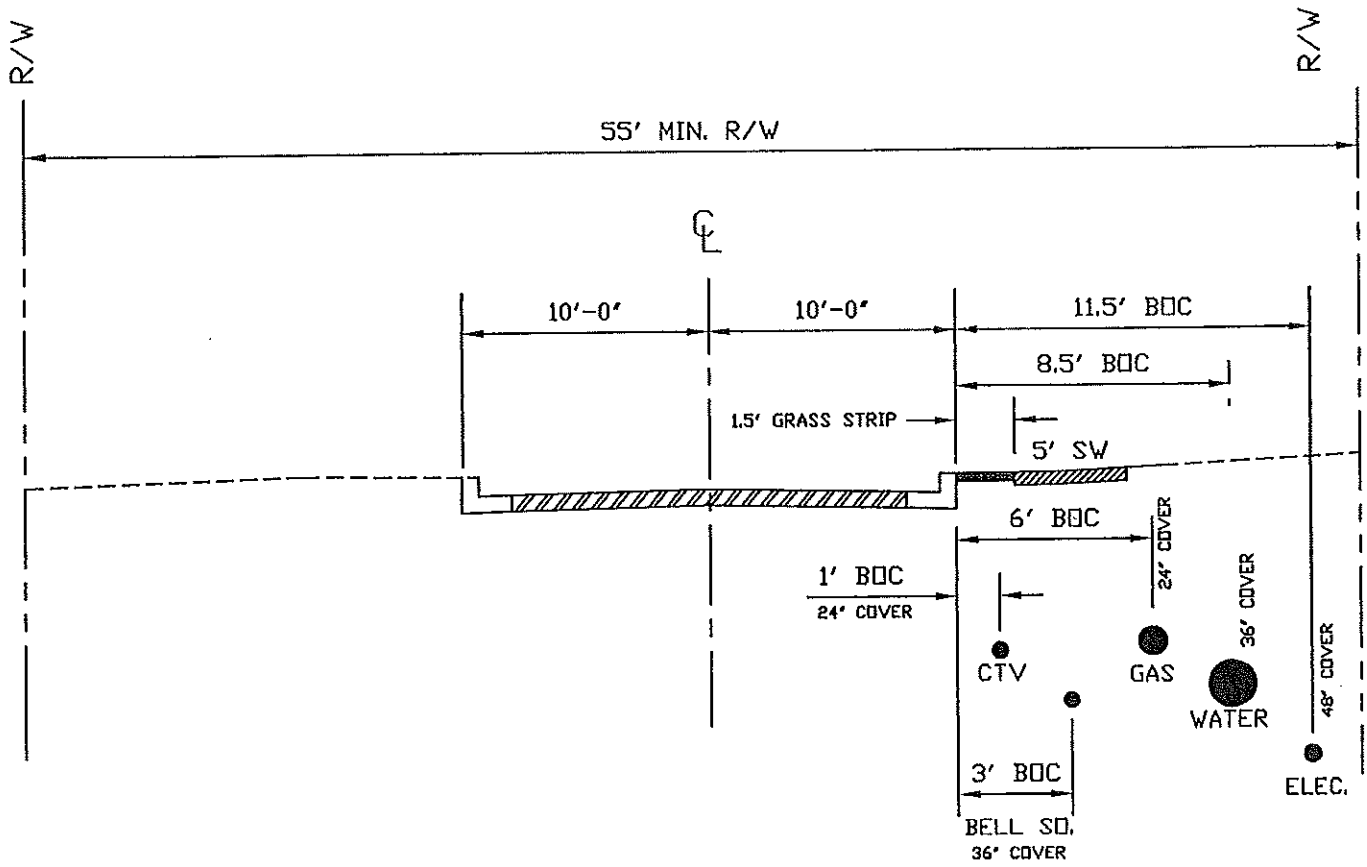

TYPICAL SECTION FOR BOTH SIDES OF STREET

NOTE NO. 1: SANITARY SEWER LOCATION SHALL BE REVIEWED ON AN INDIVIDUAL BASIS WATER AND SEWER SHALL BE ON OPPOSITE SIDES OF THE STREETS..

NOTE NO. 1: WATER AND SEWER SHALL NORMALLY BE INSTALLED ALONG ONE SIDE ONLY.

LOCAL (RESIDENTIAL SUBDIVISION)
UNDERGROUND UTILITY LOCATIONS
STANDARD DETAIL 404




City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 404.DWG

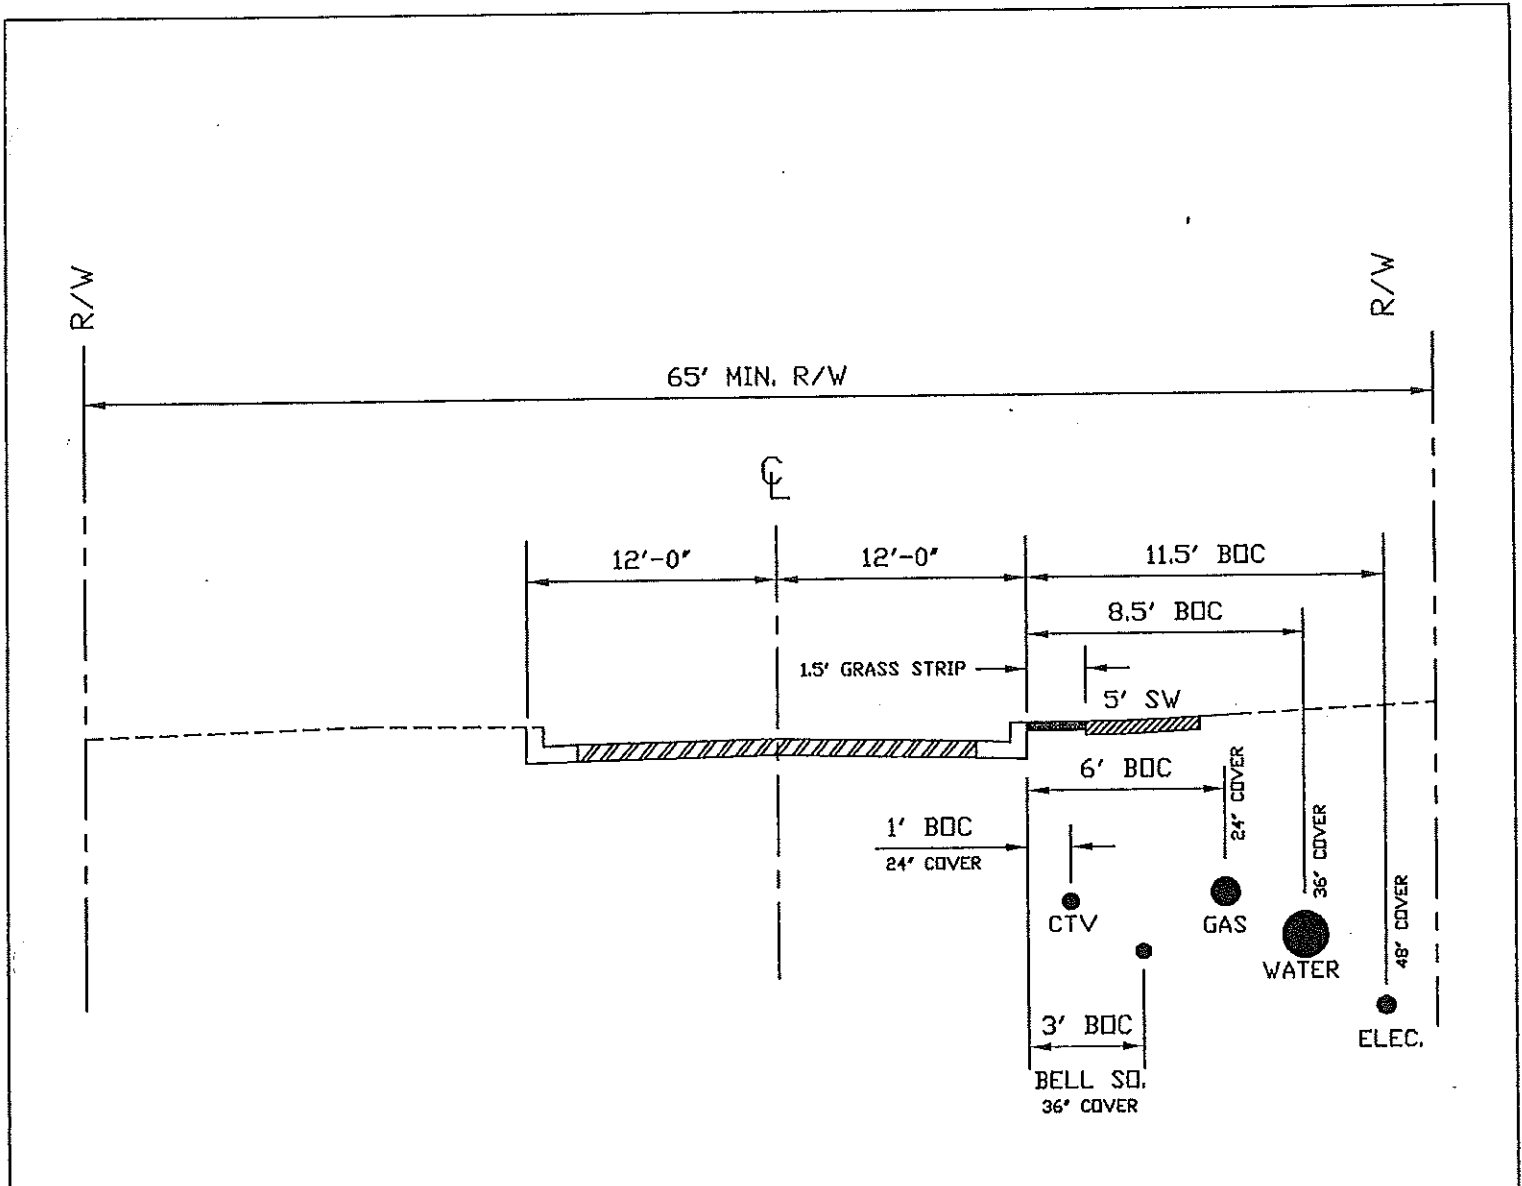

TYPICAL SECTION FOR BOTH SIDES OF STREET

NOTE NO. 1: SANITARY SEWER LOCATION SHALL BE REVIEWED ON AN INDIVIDUAL BASIS WATER AND SEWER SHALL BE ON OPPOSITE SIDES OF THE STREETS..

NOTE NO. 1: WATER AND SEWER SHALL NORMALLY BE INSTALLED ALONG ONE SIDE ONLY.

COMMERCIAL
UNDERGROUND UTILITY LOCATIONS
STANDARD DETAIL 405




City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 405.DWG

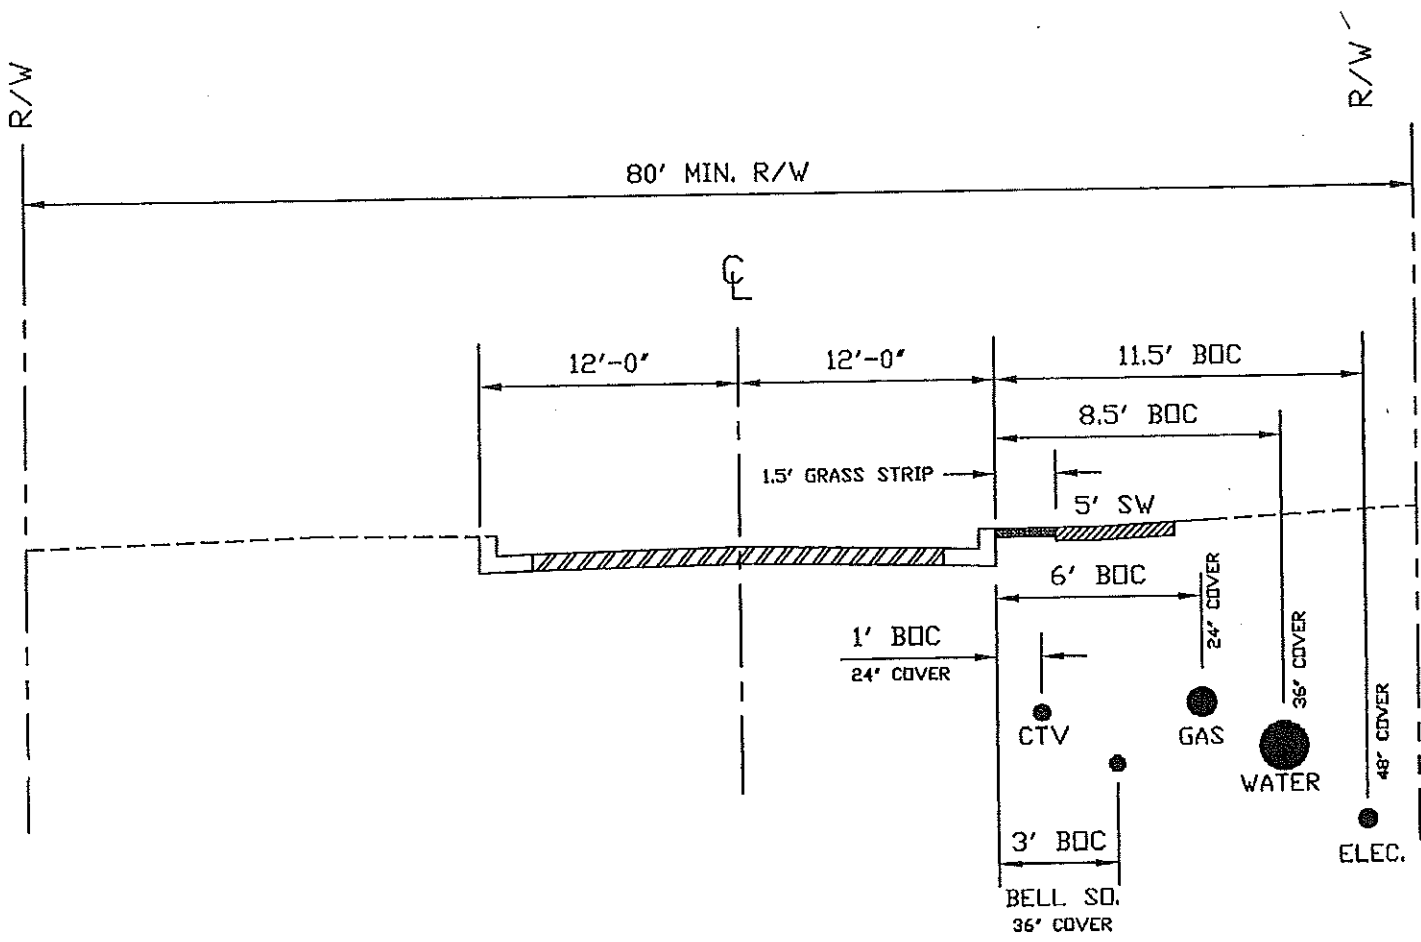

TYPICAL SECTION FOR BOTH SIDES OF STREET


NOTE NO. 1: SANITARY SEWER LOCATION SHALL BE REVIEWED ON AN INDIVIDUAL BASIS WATER AND SEWER SHALL BE ON OPPOSITE SIDES OF THE STREETS..

NOTE NO. 1: WATER AND SEWER SHALL NORMALLY BE INSTALLED ALONG ONE SIDE ONLY.


INDUSTRIAL
UNDERGROUND UTILITY LOCATIONS
STANDARD DETAIL 406



City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

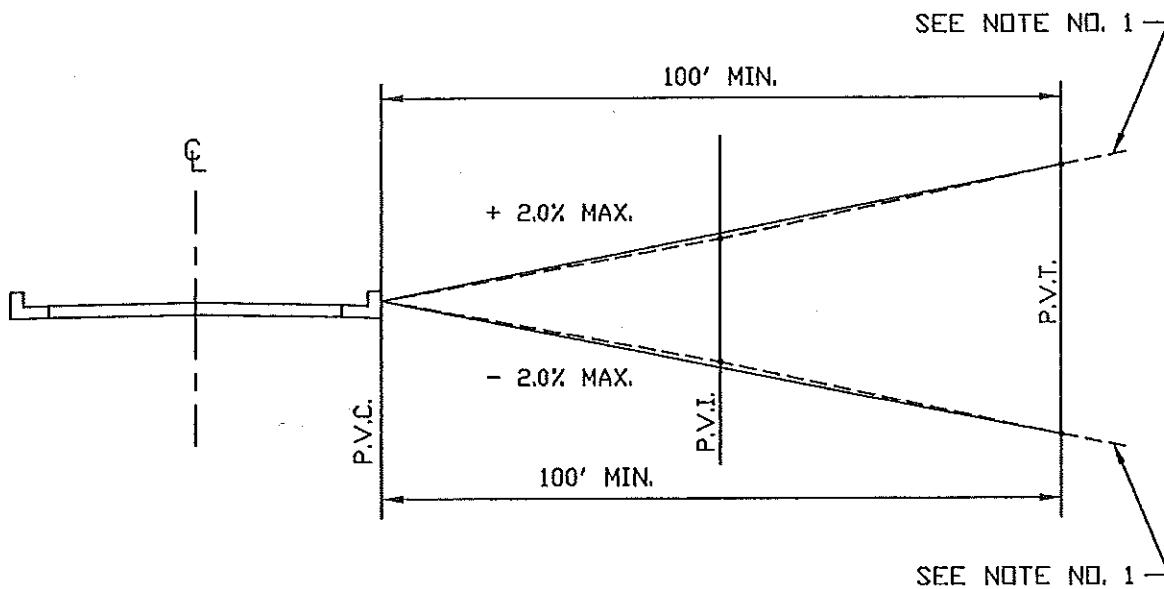

LANDING REQUIREMENTS FOR GRADES 8% OR SMALLER

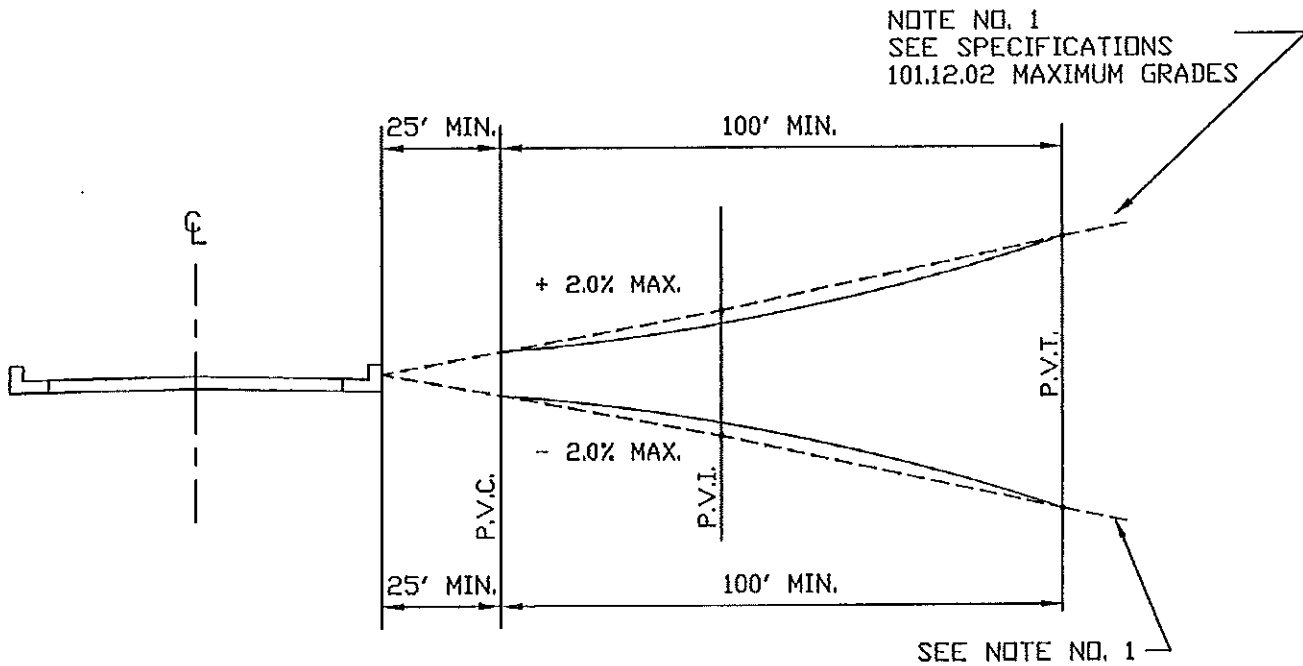

LANDING REQUIREMENTS FOR GRADES 8% OR SMALLER

LANDING REQUIREMENTS FOR STREET INTERSECTIONS
STANDARD DETAIL 407





City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 407.DWG

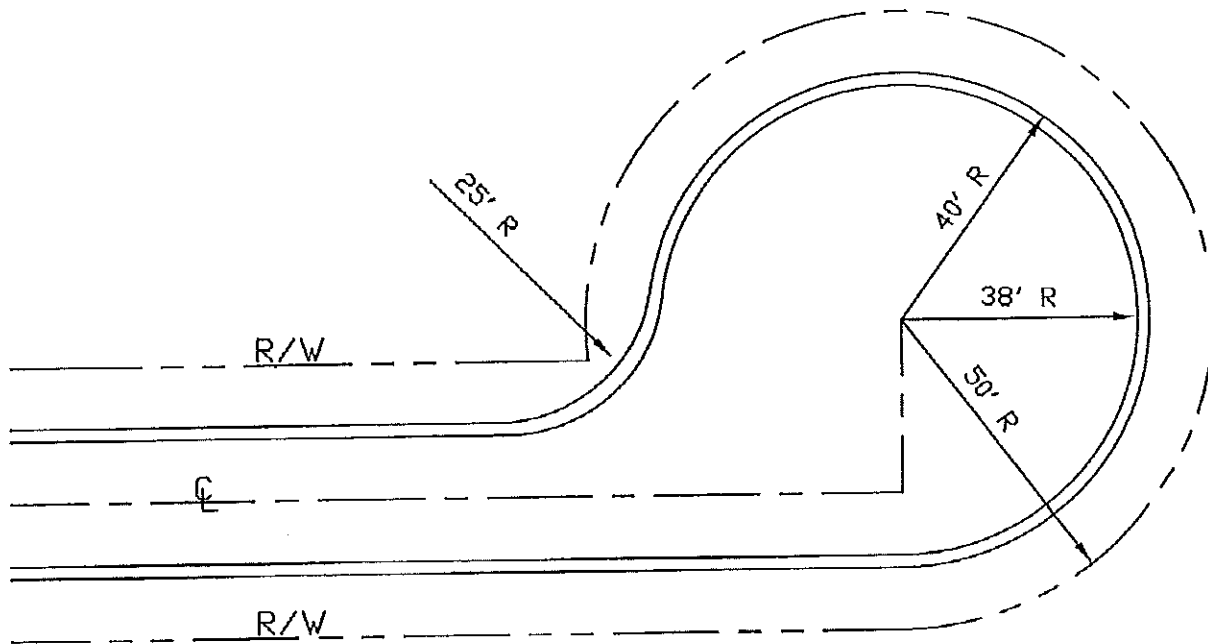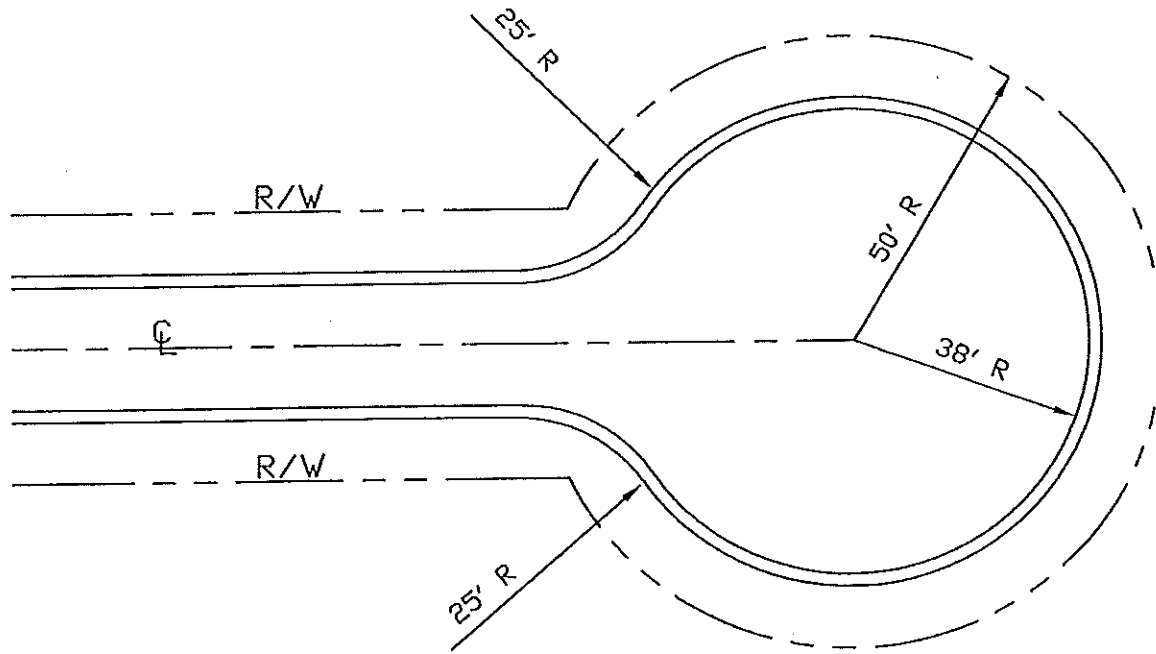

CUL-DE-SAC
STANDARD DETAILS 410 & 411



City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH


SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 410.DWG

NOTES

- 1) USE READY-MIX CONCRETE WITH 3,000 PSI STRENGTH @ 28 DAYS.
- 2) PROVIDE 1/2" DEEP CONTROL JOINT AT 10' INTERVALS.
- 3) TOOL ALL EXPOSED EDGES AND JOINTS TO 1/4" RADIUS.

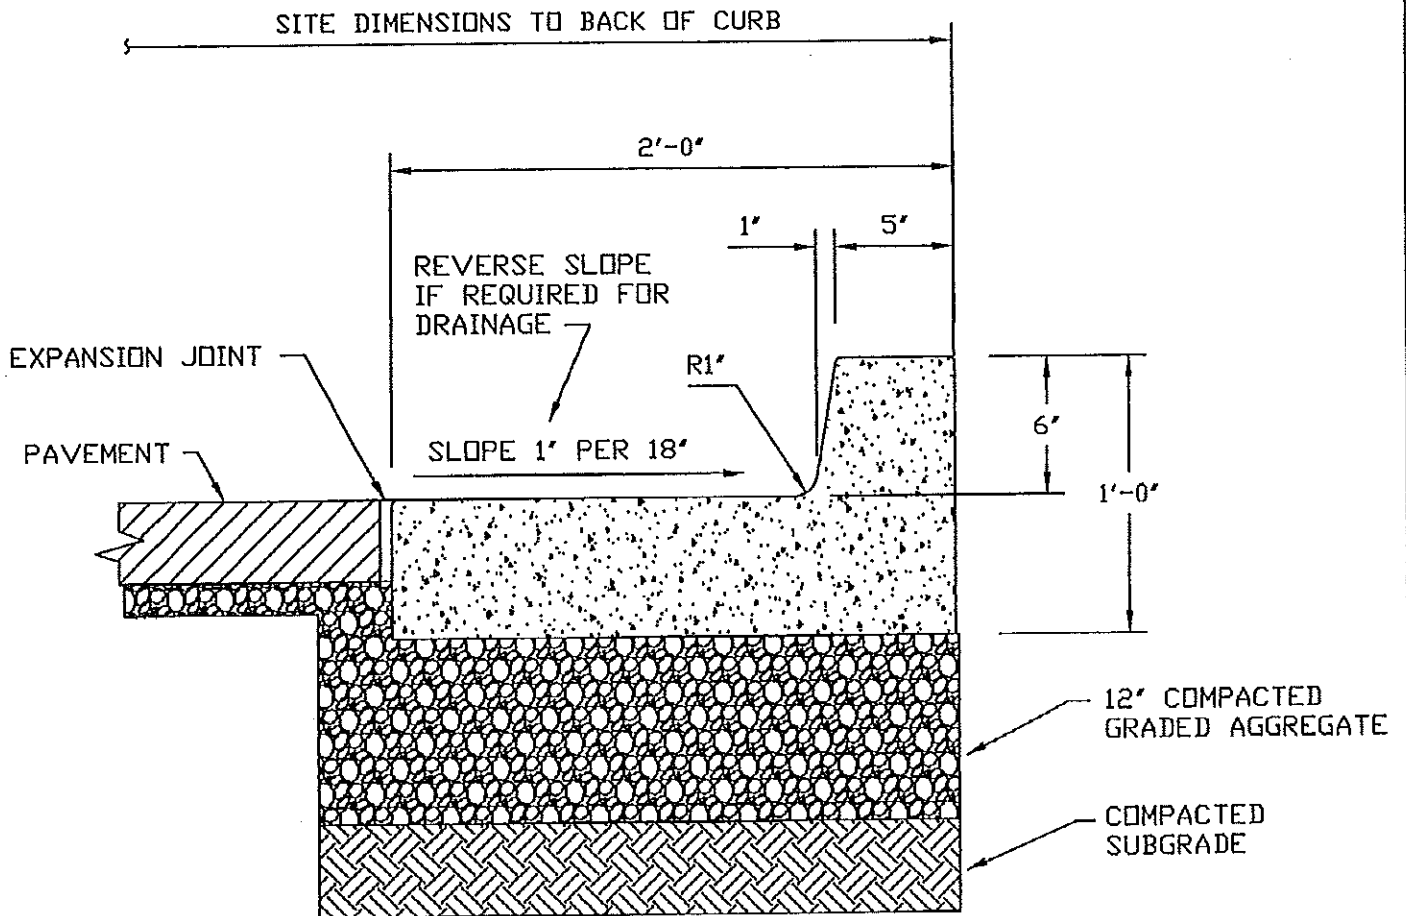

INDUSTRIAL CURB & GUTTER
STANDARD DETAIL 414



City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH


SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 414.DWG

NOTES

- 1) RESIDENTIAL USE 6" COMPACTED GRADED AGGREGATE.
COMMERCIAL USE 8" COMPACTED GRADED AGGREGATE.
- 2) USE READY-MIX CONCRETE WITH 3,000 PSI STRENGTH @ 28 DAYS.
- 3) PROVIDE 1/2" DEEP CONTROL JOINT AT 10' INTERVALS.
- 4) TOOL ALL EXPOSED EDGES AND JOINTS TO 1/4" RADIUS.

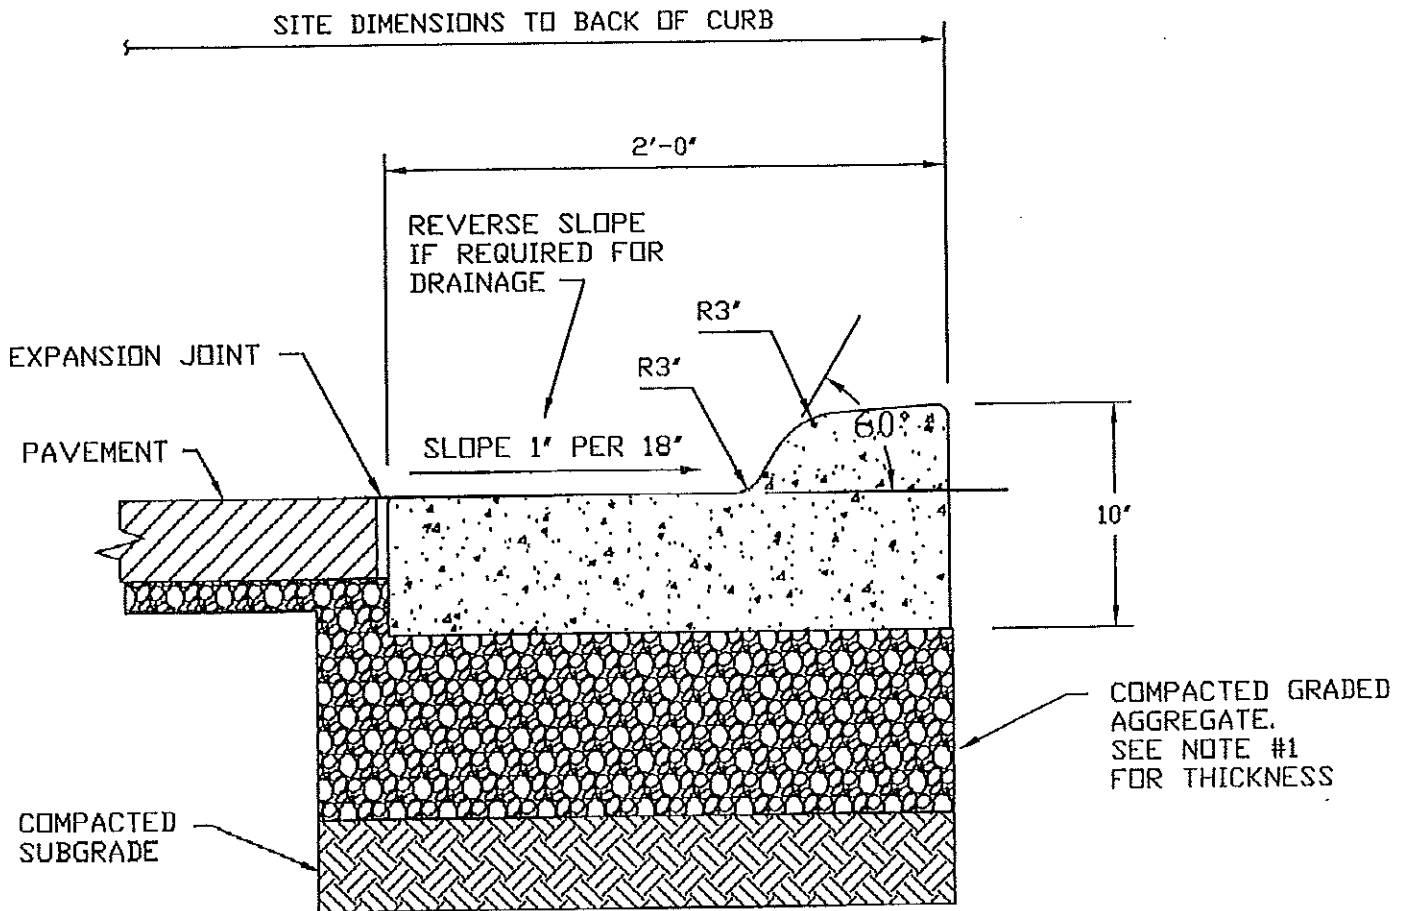

ROLL BACK CURB & GUTTER
RESIDENTIAL & COMMERCIAL
STANDARD DETAIL 414-RB



City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH


SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 414-RB.DWG

NOTES

- 1) USE READY-MIX CONCRETE WITH 3,000 PSI STRENGTH @ 28 DAYS.
- 2) TOOL ALL EXPOSED EDGES AND JOINTS TO 1/2" RADIUS.
- 3) BROOM FINISH ACROSS DIRECTION OF TRAVEL.

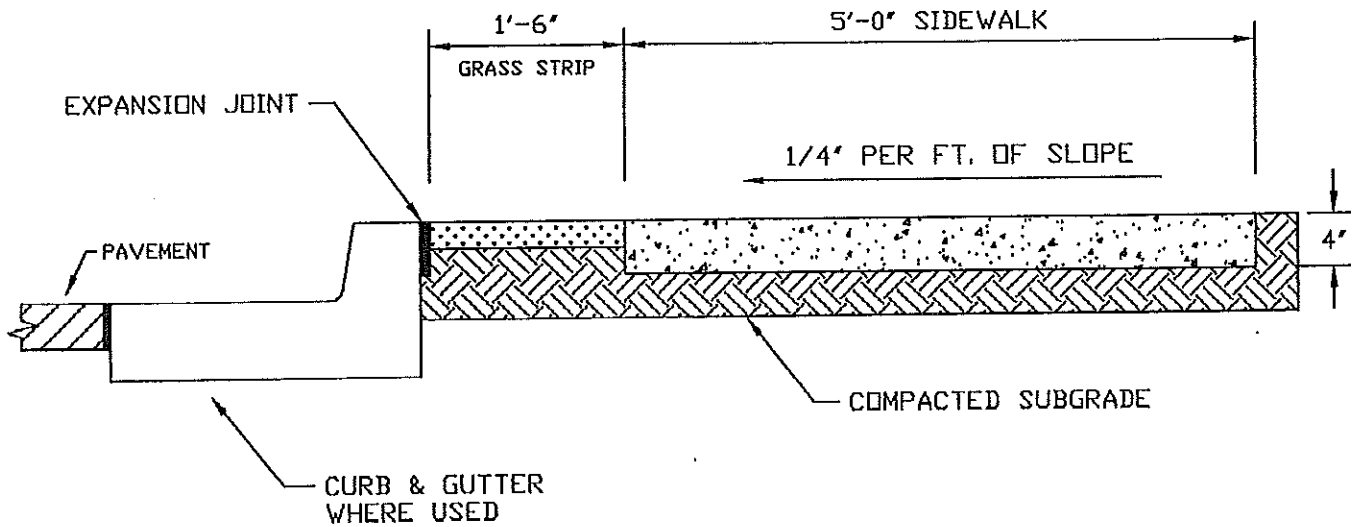

SIDEWALK DETAILS
STANDARD DETAIL 415




City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 415.DWG

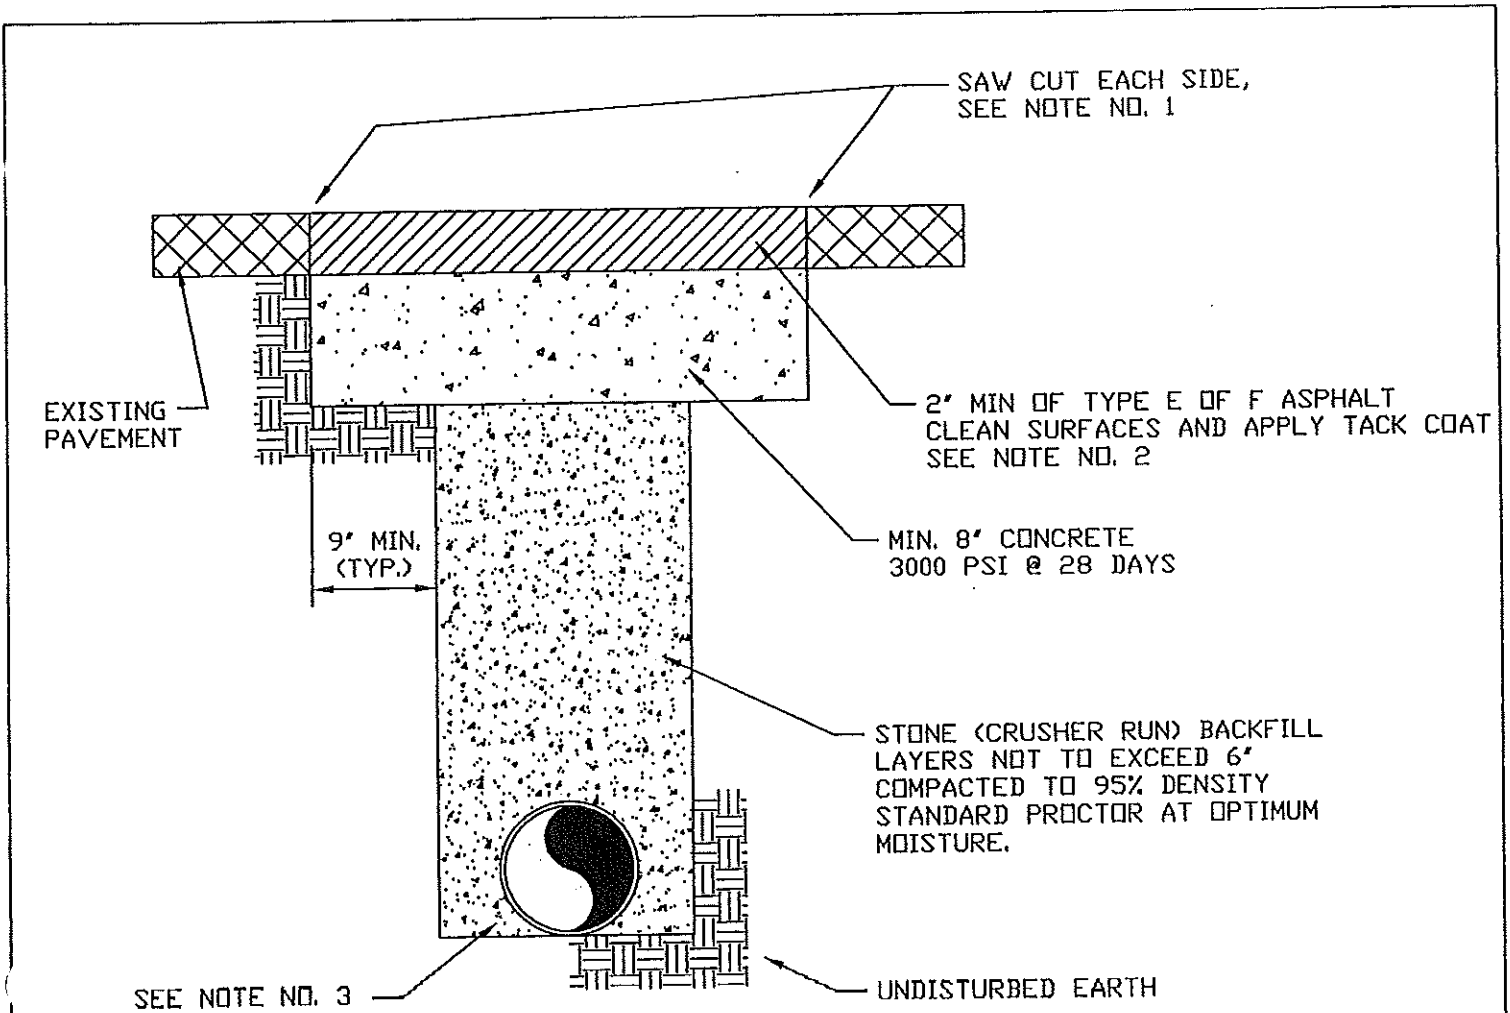

NOTE NO. 1

SAW CUTS TO FORM A NEAT LINE 9" ON EACH SIDE OF THE TRENCH OR TO VISIBLE BREAK WHICHEVER IS GREATER.

NOTE NO. 2

REMOVE AND REPLACE BASE AND PAVEMENT TO OUTER EDGE OF EXISTING PAVEMENT IF REMAINING PAVEMENT WIDTH IS 24' OR LESS.

NOTE NO. 3

SPECIAL BEDDING MAY BE REQUIRED IN AREAS WITH EXCESSIVELY WET OR YIELDING SOILS. BEDDING MAY ALSO BE REQUIRED UNDER OTHER SPECIFICATIONS.

TYPICAL STREET CUT
PAVEMENT REPLACEMENT
STANDARD DETAIL 416




City of Calhoun
Street Department
P.O. BOX 248
CALHOUN, GEORGIA 30701
TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS


DATE: JANUARY 1, 2010

DWG. NO.: 416.DWG

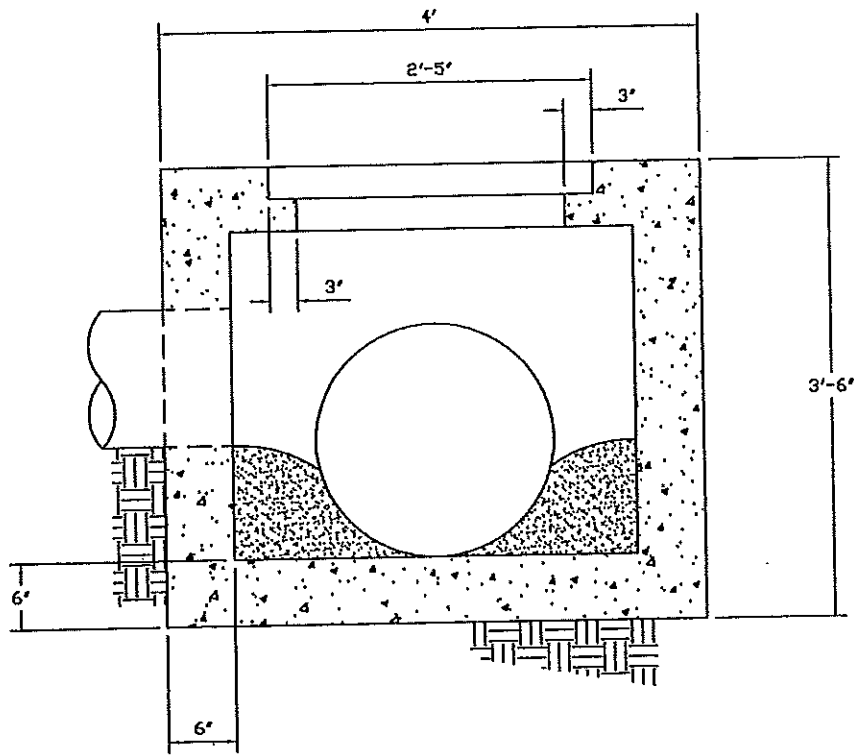

SIDE VIEW

GRATING & FRAME
 GA. D.O.T. STD. 1019A
 TYPE 'A', 'D', OR 'E'

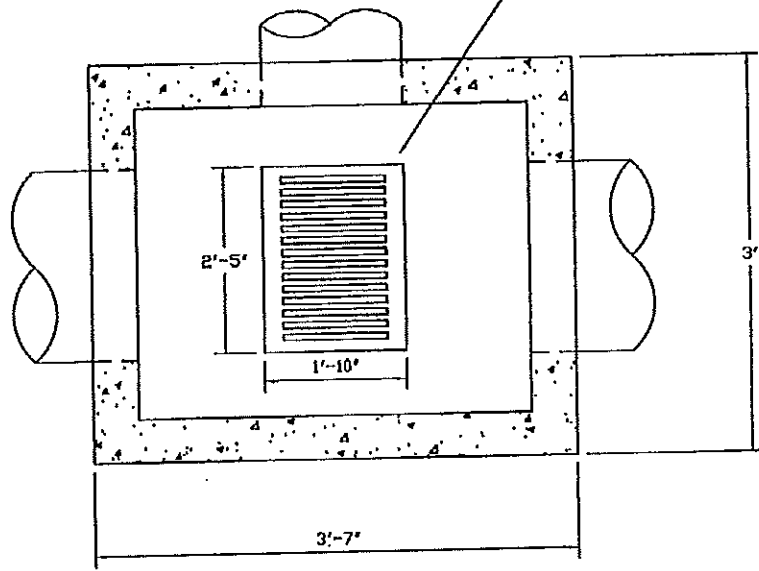

TOP VIEW

DROP INLET
 STANDARD DETAIL 418



City of Calhoun
 Street Department
 P.O. BOX 248
 CALHOUN, GEORGIA 30701
 TELEPHONE (706) 629-4473


DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: 418.DWG

TYPICAL RESIDENTIAL STREET

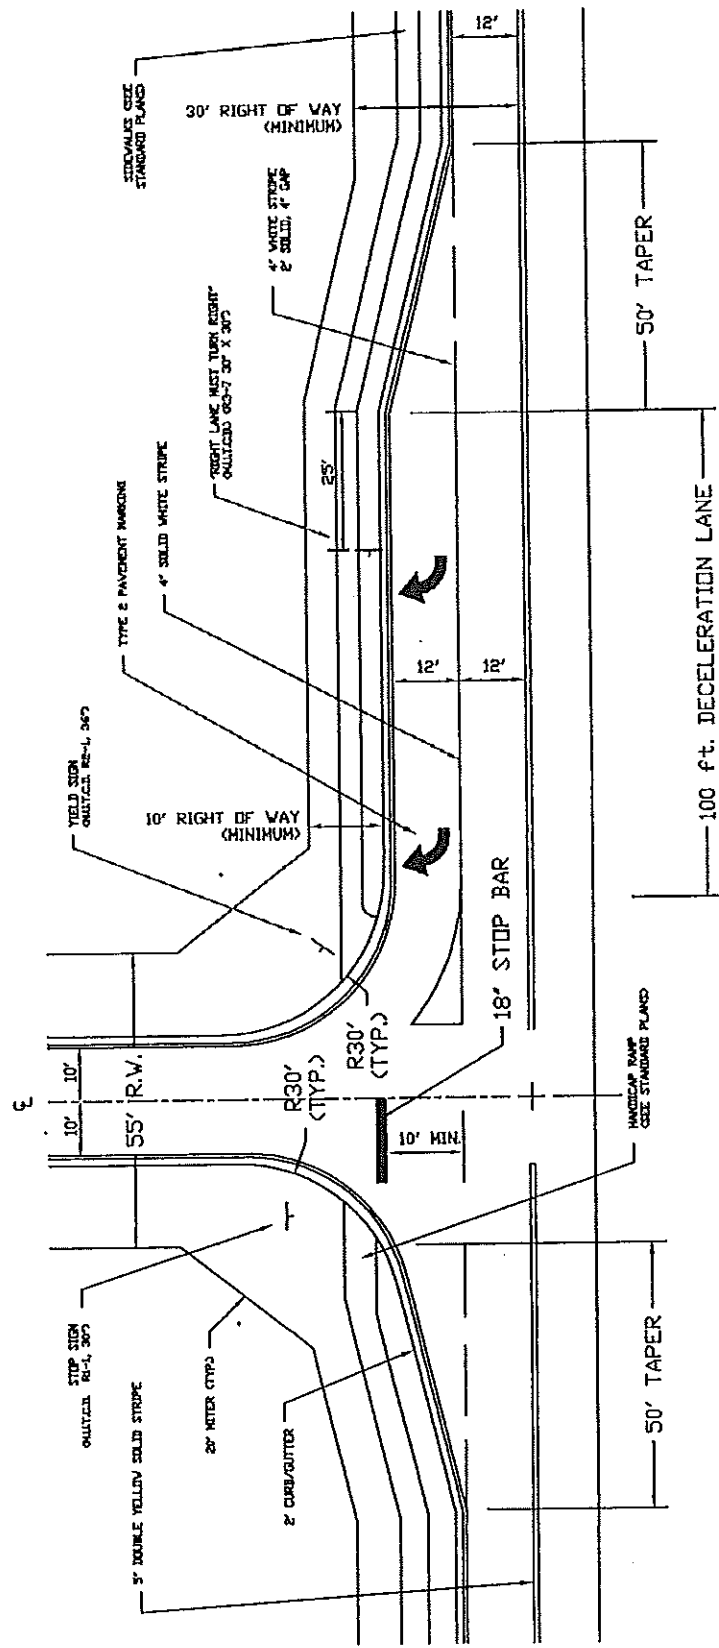

* NOTES: TAPERS ARE NOT CURVED WHEN JOINING AN UNCURVED ROAD.

SHOW THE FOLLOWING NOTES ON THE APPROVED PLAN

- A) SIGNING, STRIPING, MARKING, AND HIGH LEVEL WARNING DEVICES TO BE PLACED AS SHOWN AND/OR AS DIRECTED BY THE INSPECTOR. THIS TRAFFIC CONTROL PLAN IS SUBJECT TO CHANGE BY THE CITY OF CALHOUN STREET INSPECTOR.
- B) WARNING DEVICES SHALL BE PLACED PRIOR TO THE COMMENCEMENT OF ANY ROAD IMPROVEMENT WORK ON CITY ROADS AND SHALL REMAIN IN PLACE UNTIL THE CONCLUSION OF SIGNING & STRIPING WORK.
- C) ALL WARNING DEVICES SHALL BE EITHER TYPE I BARRICADES OR DRUMS WITH WARNING LIGHTS ON EVERY OTHER DEVICE, AND SHALL CONFORM WITH THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) STANDARDS FOR COLOR, SIZE, REFLECTIVITY, HEIGHT, AND PLACEMENT.

- D) MAXIMUM SPACING OF WARNING DEVICES SHALL BE EQUAL TO THE POSTED SPEED OF THE ROAD IN MPH. (i.e. 30 FOOT SPACING FOR 30 MPH. SPEED LIMIT)
- E) ALL SIGNS SHALL CONFORM WITH THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) STANDARDS FOR COLOR, SIZE, REFLECTIVITY, HEIGHT AND PLACEMENT.
- F) STRIPING WHITE & YELLOW AND ARROW MARKING SHALL BE APPLIED BY THE CONTRACTOR WITH PAINT OR GEORGIA DOT, STANDARD THERMOPLASTIC.
- G) CONFLICTING STRIPING SHALL BE REMOVED BY GRINDING OR OVERLAY AS SPECIFIED BY THE STREET INSPECTOR.
- H) ALL SIGNS MUST BE INSTALLED CONCURRENTLY WITH THE PERFORMANCE OF THE STRIPING WORK.

TYPICAL RESIDENTIAL STREET




City of Calhoun
 Street Department
 P.O. BOX 248
 CALHOUN, GEORGIA 30701
 TELEPHONE (706) 629-4473

DRAWN BY: DH	SCALE: NTS	DATE: JANUARY 1, 2010	DWG. NO.: RES STREET.DWG
--------------	------------	-----------------------	--------------------------

419

TYPICAL COMMERCIAL STREET

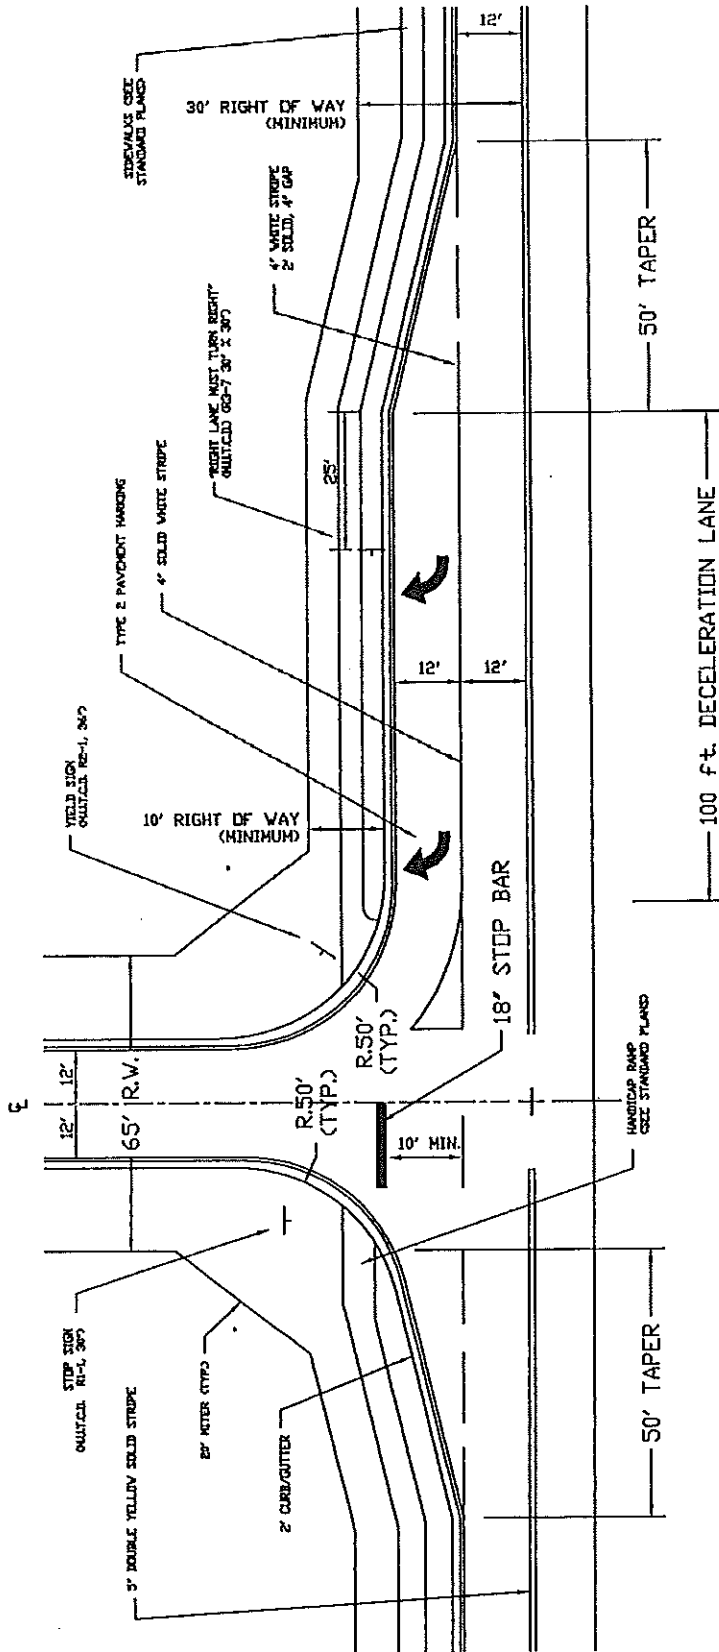

1. NOTE TAPERS ARE NOT CURVED WHEN JOINING AN UNCURVED ROAD.

SHOW THE FOLLOWING NOTES ON THE APPROVED PLAN

- A) SIGNING, STRIPING, MARKING, AND HIGH LEVEL WARNING DEVICES TO BE PLACED AS SHOWN AND/OR AS DIRECTED BY THE INSPECTOR. THIS TRAFFIC CONTROL PLAN IS SUBJECT TO CHANGE BY THE CITY OF CALHOUN STREET INSPECTOR.
- B) WARNING DEVICES SHALL BE PLACED PRIOR TO THE COMMENCEMENT OF ANY ROAD IMPROVEMENT WORK ON CITY ROADS AND SHALL REMAIN IN PLACE UNTIL THE CONCLUSION OF SIGNING & STRIPING WORK.
- C) ALL WARNING DEVICES SHALL BE EITHER TYPE 1 BARRICADES OR DRUMS WITH WARNING LIGHTS ON EVERY OTHER DEVICE AND SHALL CONFORM WITH THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) STANDARDS FOR COLOR, SIZE, REFLECTIVITY, HEIGHT, AND PLACEMENT.

- D) MAXIMUM SPACING OF WARNING DEVICES SHALL BE EQUAL TO THE POSTED SPEED OF THE ROAD IN MPH. OR, 30 FOOT SPACING FOR 30 MPH. SPEED LIMIT
- E) ALL SIGNS SHALL CONFORM WITH THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) STANDARDS FOR COLOR, SIZE, REFLECTIVITY, HEIGHT AND PLACEMENT.
- F) STRIPING (WHITE & YELLOW) AND ARROW MARKING SHALL BE APPLIED BY THE CONTRACTOR WITH PAINT OR GEORGIA DOT STANDARD THERMOPLASTIC.
- G) CONFLICTING STRIPING SHALL BE REMOVED BY GRINDING OR OVERLAY AS SPECIFIED BY THE STREET INSPECTOR.
- H) ALL SIGNS MUST BE INSTALLED CONCURRENTLY WITH THE PERFORMANCE OF THE STRIPING WORK.



City of Calhoun
 Street Department
 P.O. BOX 248
 CALHOUN, GEORGIA 30701
 TELEPHONE (706) 629-4473

TYPICAL COMMERCIAL STREET


DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: COM STREET.DWG

TYPICAL INDUSTRIAL STREET

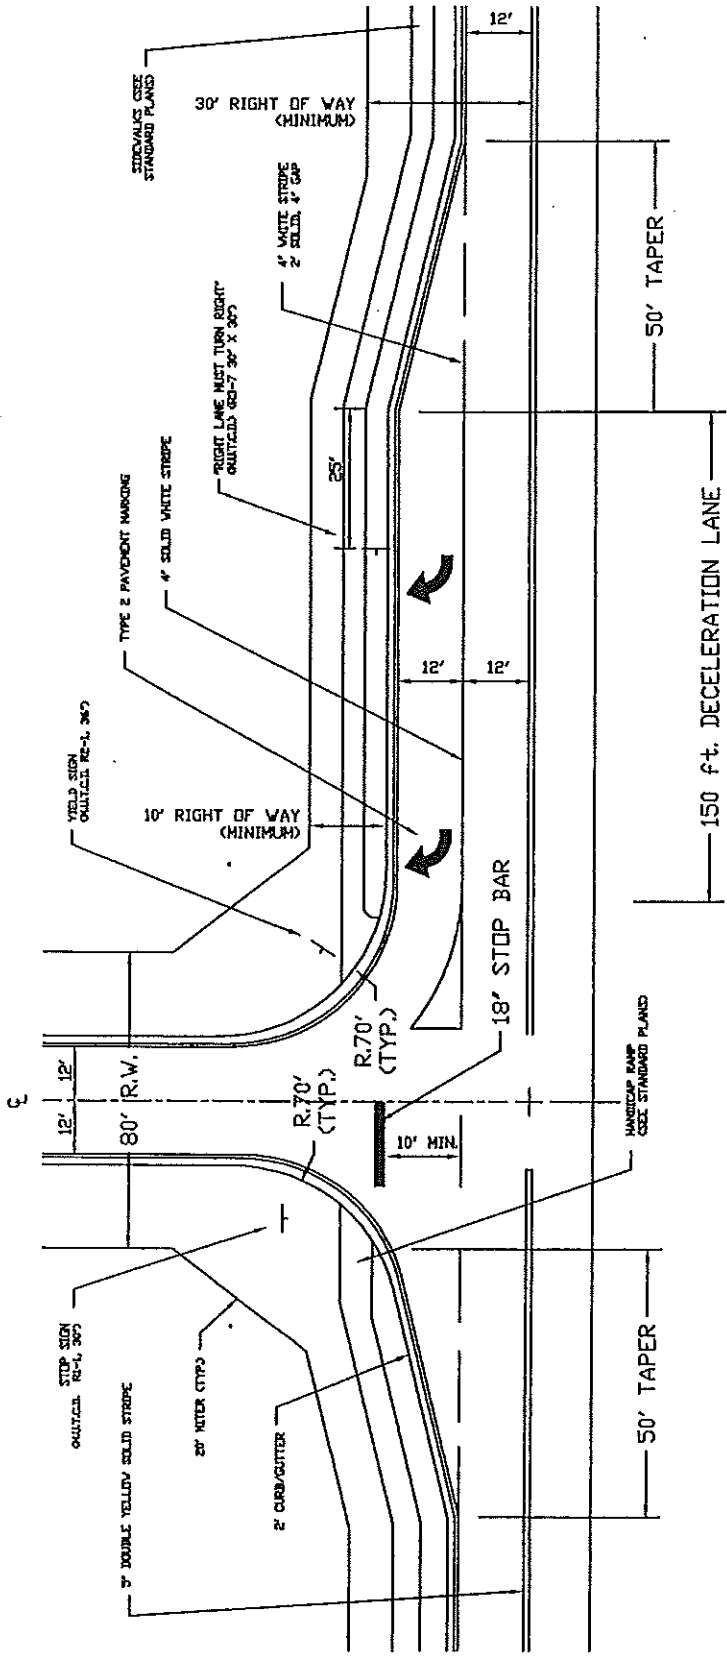

* NOTE: TAPERS ARE NOT CURVED WHEN JOINING AN INCURVED ROAD.

SHOW THE FOLLOWING NOTES ON THE APPROVED PLAN

- A) SIGNING, STRIPING, MARKING, AND HIGH LEVEL WARNING DEVICES TO BE PLACED AS SHOWN AND/OR AS DIRECTED BY THE INSPECTOR. THIS TRAFFIC CONTROL PLAN IS SUBJECT TO CHANGE BY THE CITY OF CALHOUN STREET INSPECTOR.
- B) WARNING DEVICES SHALL BE PLACED PRIOR TO THE COMMENCEMENT OF ANY ROAD IMPROVEMENT WORK ON CITY ROADS AND SHALL REMAIN IN PLACE UNTIL THE CONCLUSION OF SIGNING & STRIPING WORK.
- C) ALL WARNING DEVICES SHALL BE EITHER TYPE I BARRICADES OR DRUMS WITH WARNING LIGHTS ON EVERY OTHER DEVICE, AND SHALL CONFORM WITH THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) STANDARDS FOR COLOR, SIZE, REFLECTIVITY, HEIGHT, AND PLACEMENT.

- D) MAXIMUM SPACING OF WARNING DEVICES SHALL BE EQUAL TO THE POSTED SPEED OF THE ROAD IN MPH. OR, 30 FOOT SPACING FOR 30 M.P.H. SPEED LIMIT.
- E) ALL SIGNS SHALL CONFORM WITH THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) STANDARDS FOR COLOR, SIZE, REFLECTIVITY, HEIGHT AND PLACEMENT.
- F) STRIPING (WHITE & YELLOW) AND ARROW MARKING SHALL BE APPLIED BY THE CONTRACTOR WITH PAINT OR GEORGIA DOT'S STANDARD THERMOPLASTIC.
- G) CONFLICTING STRIPING SHALL BE REMOVED BY GRINDING OR OVERLAY AS SPECIFIED BY THE STREET INSPECTOR.
- H) ALL SIGNS MUST BE INSTALLED CONCURRENTLY WITH THE PERFORMANCE OF THE STRIPING WORK.

TYPICAL INDUSTRIAL STREET



City of Calhoun
 Street Department
 P.O. BOX 248
 CALHOUN, GEORGIA 30701
 TELEPHONE (706) 629-4473

DRAWN BY: DH

SCALE: NTS

DATE: JANUARY 1, 2010

DWG. NO.: IND STREET.DWG